


THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS. THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPLIANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES. VERIFY WITH LOCAL BUILDINGS OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION. CHANGES OR MODIFICATIONS TO PIPING OR DESIGN IS NOT TO BE PERFORMED WITHOUT EXPRESSED WRITTEN PERMISSION BY NAVIEN, INC.

NOTE:
TANKLESS MODELS SHOWN ARE
EXTERIOR/OUTDOOR MOUNTED
UNITS.

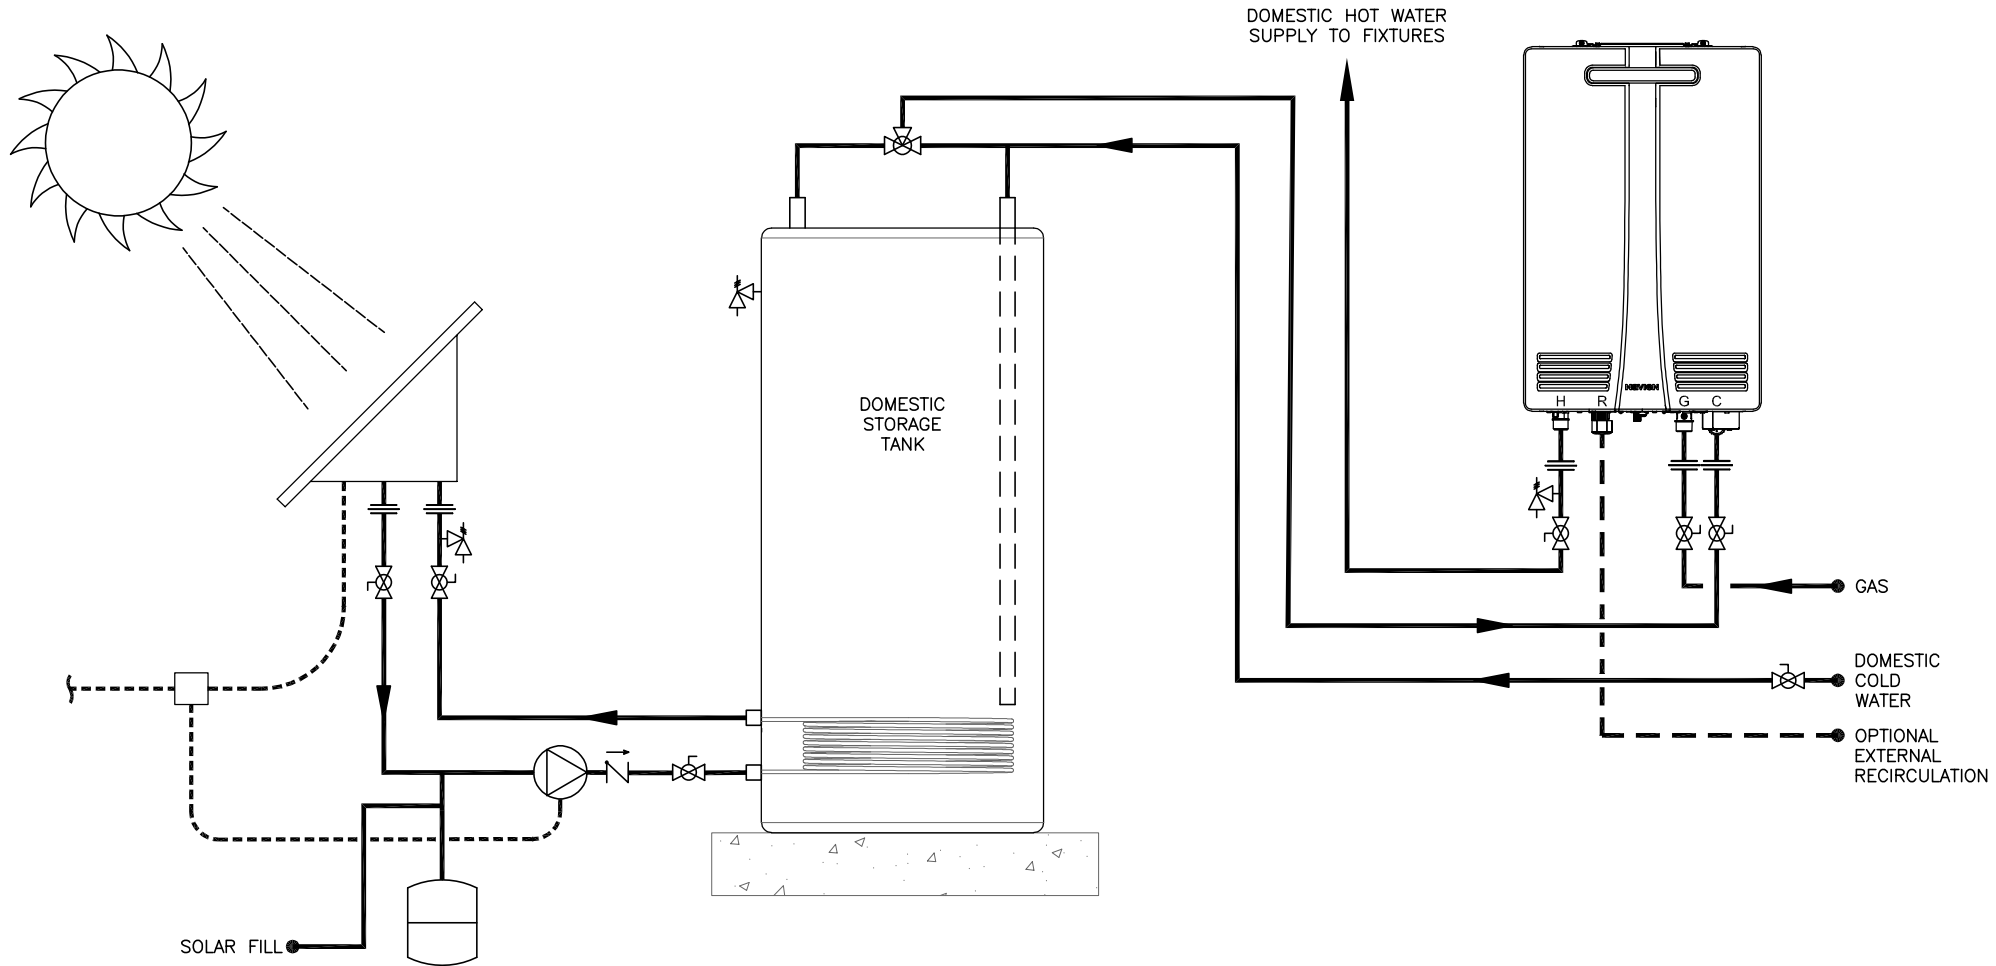

TANKLESS QUANTITY: RECOMMENDED PIPE SIZE	1 UNIT: 3/4"	2 UNITS: 1"	3 UNITS: 1-1/4"	4-5 UNITS: 1-1/2"	6-8 UNITS: 2"	9-14 UNITS: 2-1/2"	15-16 UNITS: 3"	SYMBOL LEGEND			
NAVIENT 20 GOODYEAR IRVINE, CA 92618 800-519-8794 www.navienc.com								UNION	CHECK VALVE	FULL-PORT VALVE	AQUASTAT
(1) NHW-AE TANKLESS WATER HEATER STANDARD INSTALLATION WITH SOLAR APPLICATION INCLUDES MODELS 160, 180 AND 199									PRESSURE RELIEF VALVE	CIRCULATOR	MIXING VALVE
DRAWN BY: S. STOEKE		NHW-AE-1-S			JULY 27, 2023			SOLAR PANEL	DOMESTIC STORAGE TANK		