


THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS. THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPLIANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES. VERIFY WITH LOCAL BUILDING OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION. CHANGES OR MODIFICATIONS TO PIPING OR DESIGN IS NOT TO BE PERFORMED WITHOUT EXPRESSED WRITTEN PERMISSION BY NAVIEN, INC.

**NOTE:**

APPLICATIONS WITH A MIXTURE OF NAVIEN NPE-A2 (CIRCULATION) AND NPE-S2 (STANDARD), THE FOLLOWING SHALL APPLY:

1. 50% OF TANKLESS UNITS SHALL BE NPE-A2 MODELS.
2. MINIMUM OF (2) NPE-A2 MODELS (2 OF 3-4, 3 OF 6)

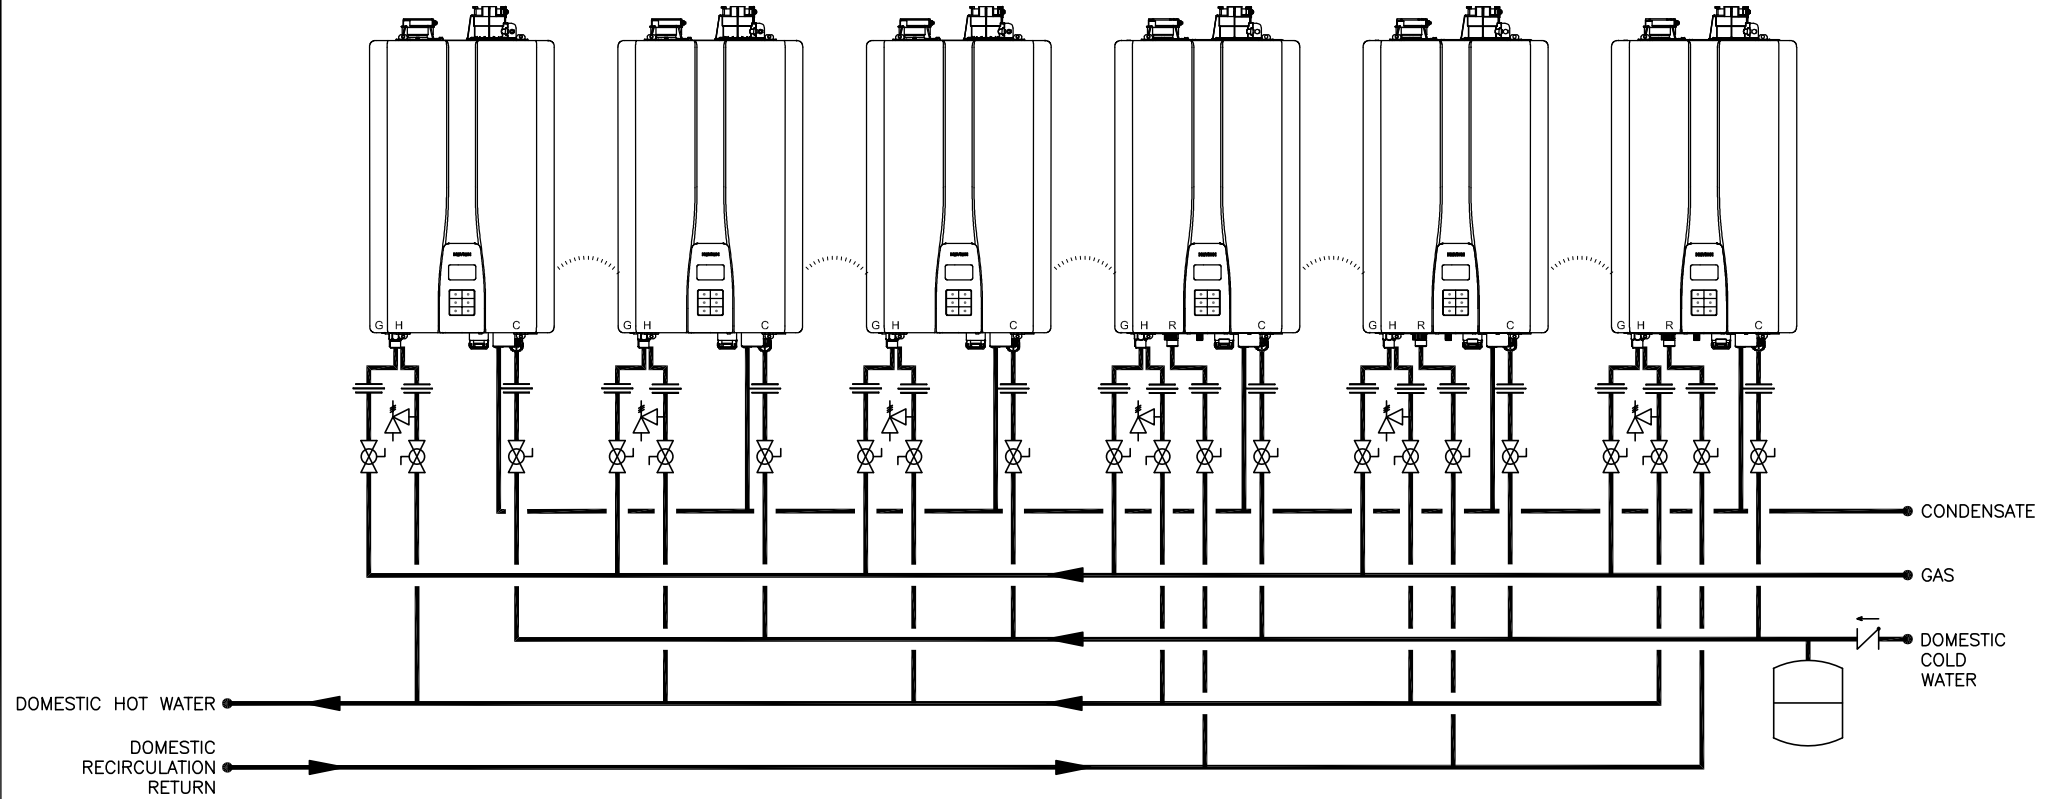

<p>20 GOODYEAR IRVINE, CA 92618 800-519-8794 www.navienc.com</p>	TANKLESS QUANTITY: RECOMMENDED PIPE SIZE						SYMBOL LEGEND				
	1 UNIT: 3/4"	2 UNITS: 1"	3 UNITS: 1-1/4"	4-5 UNITS: 1-1/2"	6-8 UNITS: 2"	9-14 UNITS: 2-1/2"	15-16 UNITS: 3"	UNION	CHECK VALVE	FULL-PORT VALVE	EXPANSION TANK
<p>NPE-A2/S2 SERIES TANKLESS WATER HEATER</p> <p>(6) NPE-A2/NPE-S2 TANKLESS WATER HEATERS WITH EXTERNAL RECIRCULATION MODE INCLUDES MODELS 150(NPE-S2 ONLY), 180, 210 AND 240</p>											
DRAWN BY: S. STOKE			NPE-A2-S2-6-E			MAY 13, 2022			CASCAD CABLE PRESSURE RELIEF VALVE		