


THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS. THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPLIANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES. VERIFY WITH LOCAL BUILDINGS OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION. CHANGES OR MODIFICATIONS TO PIPING OR DESIGN IS NOT TO BE PERFORMED WITHOUT EXPRESSED WRITTEN PERMISSION BY NAVIEN, INC.

NOTE:

APPLICATIONS WITH A MIXTURE OF NAVIEN NPE-A2 (CIRCULATION) AND NPE-S2 (STANDARD), THE FOLLOWING SHALL APPLY:

1. 50% OF TANKLESS UNITS SHALL BE NPE-A2 MODELS.
2. MINIMUM OF (2) NPE-A2 MODELS (2 OF 3-4, 3 OF 6)

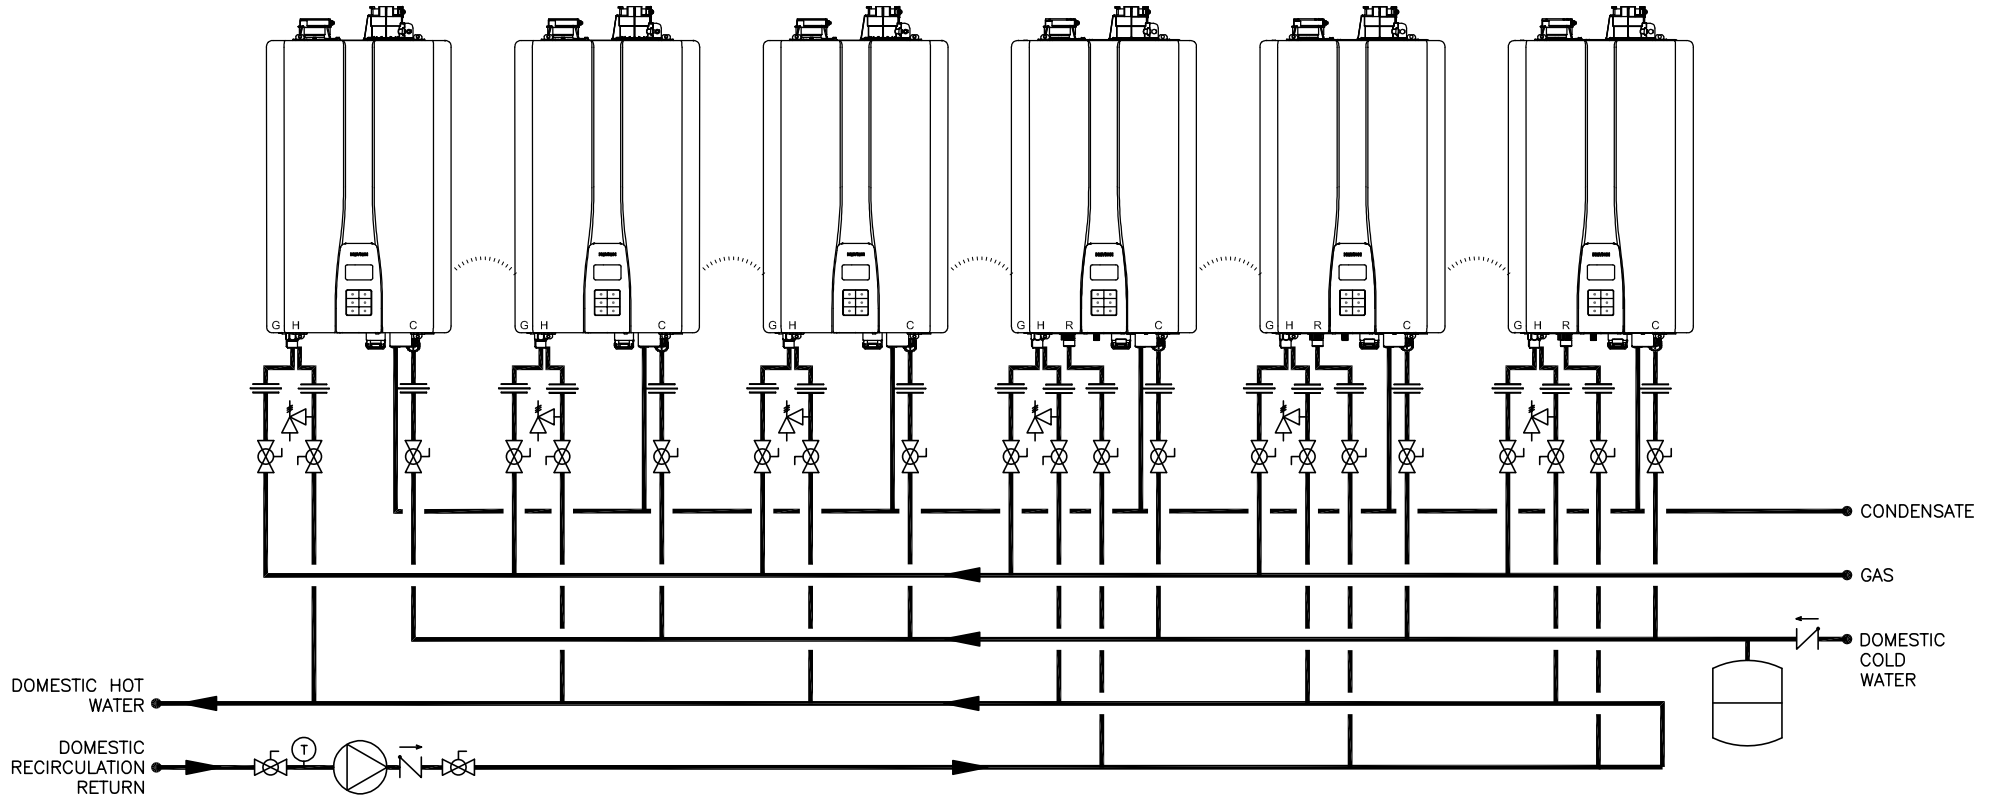

<p>20 GOODYEAR IRVINE, CA 92618 800-519-8794 www.navienc.com</p>	TANKLESS QUANTITY: RECOMMENDED PIPE SIZE	1 UNIT: 3/4"	2 UNITS: 1"	3 UNITS: 1-1/4"	4-5 UNITS: 1-1/2"	6-8 UNITS: 2"	9-14 UNITS: 2-1/2"	15-16 UNITS: 3"	SYMBOL LEGEND				
	NPE-A2/S2 SERIES TANKLESS WATER HEATER (6) NPE-A2/S2 TANKLESS WATER HEATERS WITH EXTERNAL RECIRCULATION MODE WITH EXTERNAL CIRCULATOR INCLUDES MODELS 150(NPE-S2 ONLY), 180, 210 AND 240									UNION	CHECK VALVE	FULL-PORT VALVE	EXPANSION TANK
	CASCADE CABLE	PRESSURE RELIEF VALVE	CIRCULATOR	AQUASTAT	DHW CIRCULATOR W/ AQUASTAT, OPTIONAL TIMER & CHECK VALVE								
DRAWN BY: S. STOEKE	NPE-A2-S2-6-E-EC			JULY 27, 2023									